



P.O. Box 670 Hoschton GA 30548 USA
Tel: (706) 654-3232 Fax: (706) 654-3888
E-Mail: sales@ibis-usa.com <http://www.ibis-usa.com>

Technical Bulletin 080212


DIFFERENTIAL PRESSURE SWITCH SETTING

ADJUSTMENT

To change the set point, proceed as follows:

A. Remove the snap-on cover from the conduit enclosure by loosening its retaining screw and pulling firmly at its bottom end. Turn the slotted adjustment screw at the top of range spring housing clockwise to raise the set point pressure and counter-clockwise to lower the set point.

B. The recommended procedure for calibrating or checking calibration is to use a piece of tubing attached to the high pressure side of the switch. Lightly blow into the tubing while keeping an eye on the pressure gauge and warning light and listen for alarm if equipped. If alarm or light are not present listen for a slight clicking coming from the switch. Adjust the set screw until you have reached your desired differential pressure.

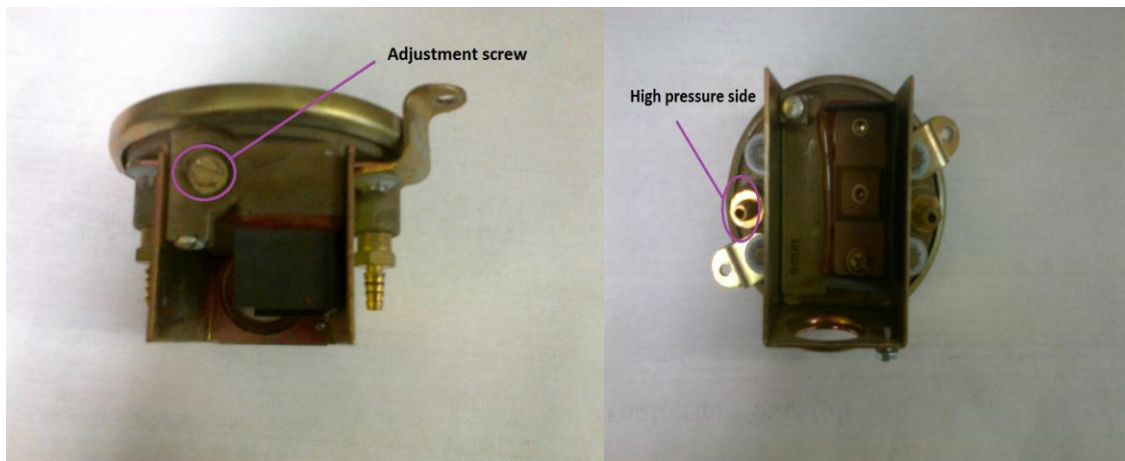

DIFFERENTIAL PRESSURE SWITCH SETTING

C. RECOMMENDED SETTINGS

Drum filter media DP = 3" WC

Stage 2 Dust Loc sock filter DP = 1" WC

Stage 3 Hi Flo ES bag filter DP = 1.5" WC

ibis...your global air and fiber handling specialist